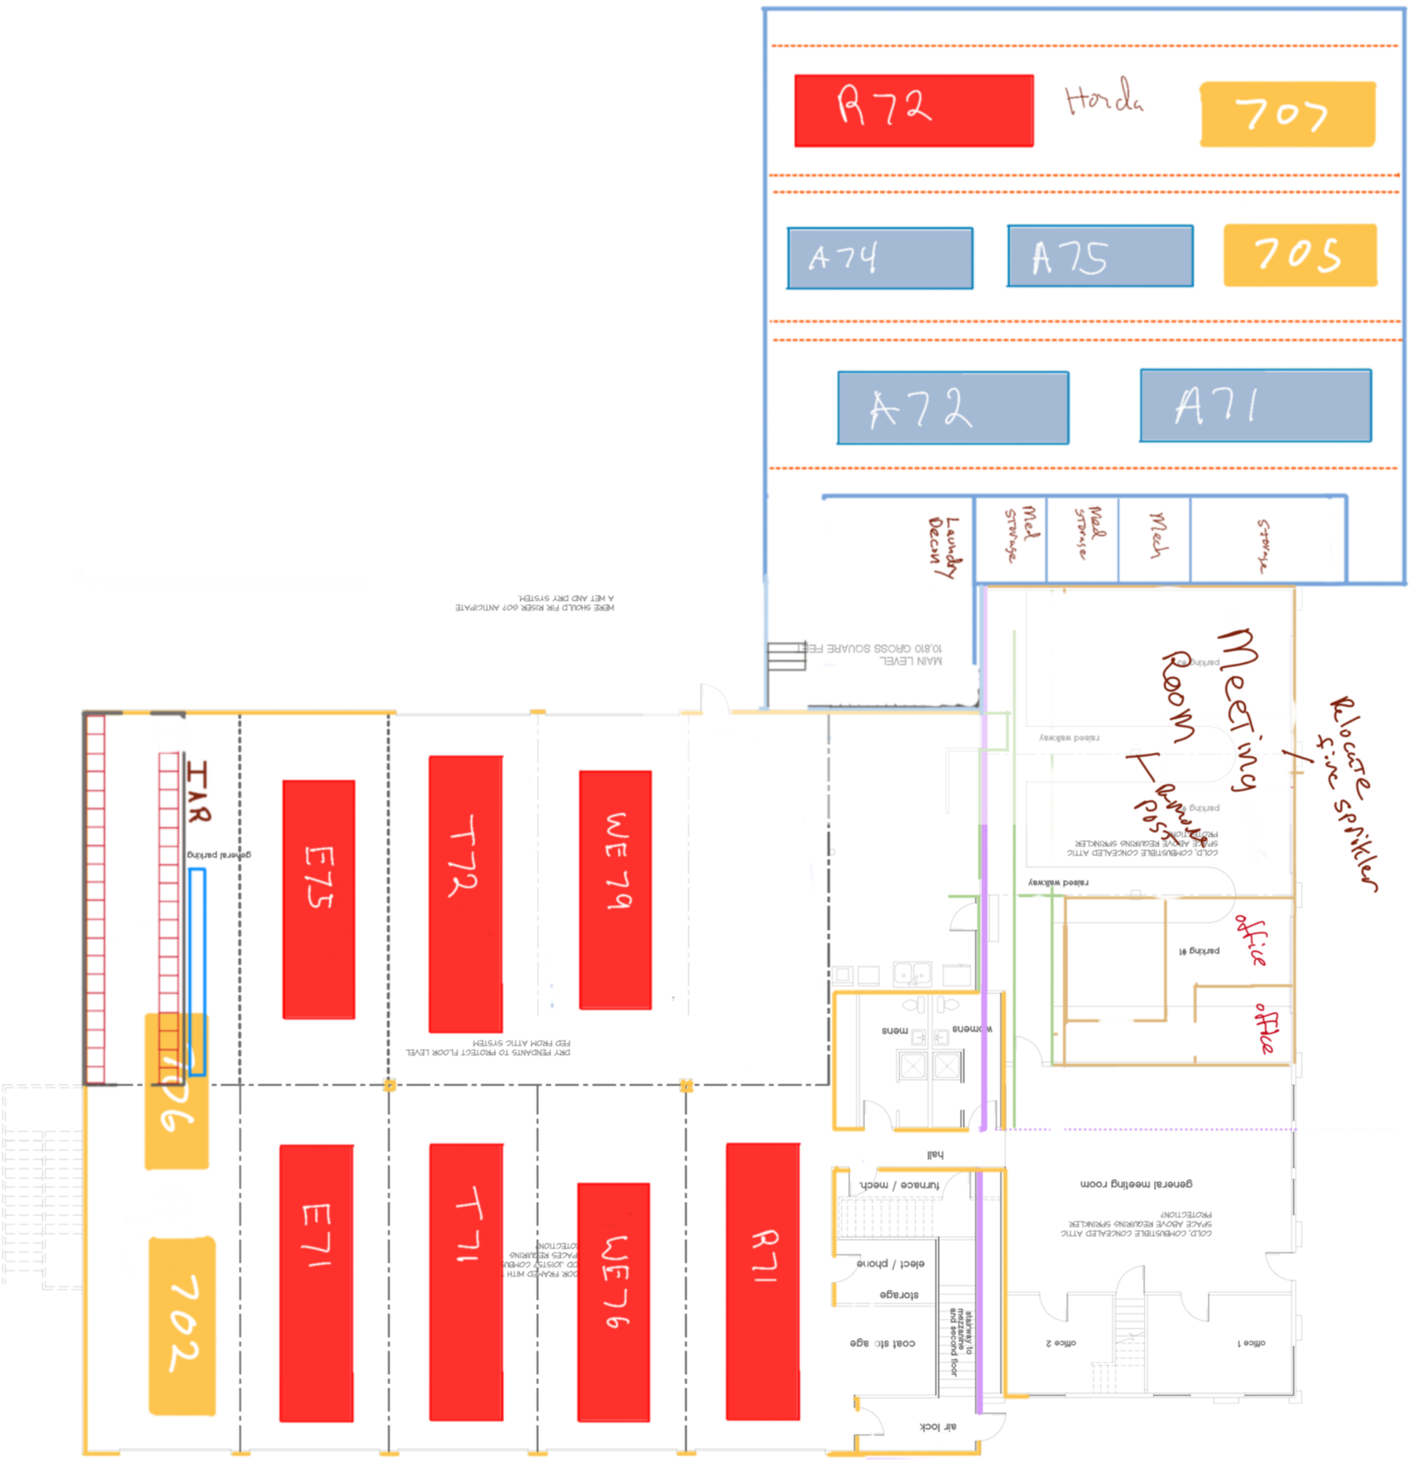
R72
Horda
707
A74
A75
705
A72
A71
Laundry Decon
Med storage
Med storage
Mech
storage
Meeting Room
Relocate fire sprinkler
Lounge Possible
raised walkway
parking
COLD, COMBUSTIBLE CONCEALED ATTIC SPACE ABOVE REQUIRING SPRINKLER PROTECTION
office
office
parking
raised walkway
womens
mens
general meeting room
COLD, COMBUSTIBLE CONCEALED ATTIC SPACE ABOVE REQUIRING SPRINKLER PROTECTION
hall
furnace / mech.
air lock
coat / etc. storage
storage
elect / phone
office 1
office 2
WE79
T72
E75
706
702
WE76
T71
E71
R71
DRY PENDANTS TO PROTECT FLOOR LEVEL FED FROM ATTIC SYSTEM
general parking
IAR
MAIN LEVEL
10,810 GROSS SQUARE FEET
WERE SHOULD FIR RISER 607 ANTICIPATE A WET AND DRY SYSTEM.